

**NFRC U-FACTOR, SHGC, VT, &
CONDENSATION RESISTANCE
COMPUTER SIMULATION REPORT**

**Rendered to:
MGM INDUSTRIES**

**SERIES/MODEL:
4600 Double Hung**

<i>Baseline Product for Validation Testing</i>	
Simulated Thermal Transmittance (U-Factor)	0.30
Unit Size:	47.25" wide by 59.00" high
Glazing Layer 1:	SS Clear
Gap 1:	0.688" DuraSeal Spacer (A8-D) - 90% Argon Fill
Glazing Layer 2:	SS Guardian RLE 71/38 (e=0.027,#3)
Gap 2:	
Glazing Layer 3:	
Notes:	

Report Number: 68234.09-116-45
Report Date: 03/19/09
Expiration Date: 10/09/10

**NFRC U-FACTOR, SHGC, VT, & CONDENSATION RESISTANCE
COMPUTER SIMULATION REPORT**

Rendered to:
MGM INDUSTRIES
287 Freehill Road
Hendersonville, Tennessee 37075

Report Number: 68234.09-116-45
Simulation Date: 10/09/06
Report Date: 03/19/09
Expiration Date: 10/09/10

Project Summary:

Architectural Testing, Inc. was contracted to perform U-Factor, Solar Heat Gain Coefficient, Visible Transmittance, and Condensation Resistance* computer simulations in accordance with the National Fenestration Rating Council (NFRC). The products were evaluated in full compliance with NFRC requirements to the standards listed below.

**NFRC's Condensation Resistance rating is NOT equivalent to a Condensation Resistance Factor (CRF) determined in accordance with AAMA 1503.*

Standards:

NFRC 100-2004: Procedure for Determining Fenestration Product U-Factors
NFRC 200-2004: Procedure for Determining Fenestration Product Solar Heat Gain Coefficient and Visible Transmittance at Normal Incidence
NFRC 500-2004: Procedure for Determining Fenestration Product Condensation Resistance Values

Software:

Frame and Edge Modeling: THERM 5.2.14
Center-of-Glass Modeling: WINDOW 5.2.17
Total Product Calculations: WINDOW 5.2.17
Spectral Data Library: 16.4

Simulations Specimen Description:

Series/Model: 4600 Double Hung
Type: Vertical Slider , Double Hung
Frame Material: VY Vinyl
Sash Material: VY Vinyl
Standard Size: 1200mm x 1500mm

Technical Interpretations:

None

Modeling Assumptions:

- 1) The DH31WW Double Hung is available in both equal and unequal lite configurations, per NFRC 100-2004, Section 4.2.1.I.i. This client only manufactures equal configuration of this product.

Specialty Products Table:

The specialty products method allow the manufacturer to determine the overall product SHGC and VT for any glazing option. The center of glass SHGC and/or VT must be determined using WINDOW 5.2. The method gives overall product SHGC and VT indexed on center of glass properties. All values used in the calculations are truncated to six decimal place precision.

	No Dividers	Dividers < 1	Dividers > 1
SHGC0	0.004320	0.007047	0.009616
SHGC1	0.757977	0.677667	0.602036
VT0	0.000000	0.000000	0.000000
VT1	0.753657	0.670619	0.592420

$$SHGC = SHGC0 + SHGCc (SHGC1 - SHGC0)$$

$$VT = VT0 + VTc (VT1 - VT0)$$

Validation Matrix:

The following products are part of a validation matrix. Only one is required for validation

<i>Product Line</i>	<i>Report Number</i>
None	-

Spacer Option Description

<i>Spacer Type</i>	<i>Sealant</i>		
	<i>Primary</i>	<i>Secondary</i>	<i>Desiccant</i>
Standard Intercept Spacer (Dual Sealed)	PIB	Polyurethane	Yes

Grid Option Description

<i>Grid Size</i>	<i>Grid Type</i>	<i>Grid Pattern</i>
3/16" x 13/16"	Aluminum Rectangular Grid	NFRC
5.5mm x 18mm	Aluminum Contour Grid	NFRC

Reinforcement Option Description

<i>Location</i>	<i>Material</i>
None	

Gas Filling Technique Description

<i>Fill Type</i>	<i>Method</i>
90% Argon	Single Probe Timed

Edge-of-Glass Construction

<i>Interior Condition</i>	Silicone bedding between sash leg and glass
<i>Exterior Condition</i>	PVC glazing bead against glass

Weatherstripping

<i>Type</i>	<i>Quantity</i>	<i>Location</i>
Mohair	2 rows	Stiles, Top Rail, Keeper Stile
Mohair	1 row	Sill, Head Adapter, Lock Stile
Hollow Bulb Gasket	1 row	Bottom Rail

**NFRC 100/200/500 Summary Sheet
4600 Double Hung**

ID	Pane Thickness 1	Gap Width 1	Pane Thickness 2	Gap Width 2	Pane Thickness 3	Gap Width 3	Pane Thickness 4	Gap Fill	Low-e (Surface#)	Tint	Spacer	Grid Type
	U-Factor			Solar Heat Gain Coefficient (SHGC) Grids (None / <1 / >=1)				Visible Transmittance (VT) Grids (None / <1 / >=1)			Condensation Resistance	
1	0.116	0.563	0.118					ARG90	0.037(#3)	LE	CU-D	N,G
	U-Factor 0.30			SHGC (N / <1 / >1) 0.35 / 0.32 / 0.28				VT (N / <1 / >1) 0.53 / 0.47 / 0.42			CR	56
1	0.118	0.563	0.116					ARG90	0.037(#2)	LE	CU-D	N,G
	U-Factor 0.30			SHGC (N / <1 / >1) 0.28 / 0.25 / 0.23				VT (N / <1 / >1) 0.53 / 0.47 / 0.42			CR	56
2	0.116	0.563	0.116					ARG90	0.022(#3)	LE	CU-D	N,G
	U-Factor 0.30			SHGC (N / <1 / >1) 0.30 / 0.27 / 0.24				VT (N / <1 / >1) 0.49 / 0.43 / 0.38			CR	56
2	0.116	0.563	0.116					ARG90	0.022(#2)	LE	CU-D	N,G
	U-Factor 0.30			SHGC (N / <1 / >1) 0.21 / 0.19 / 0.17				VT (N / <1 / >1) 0.49 / 0.43 / 0.38			CR	56

This report is reissued in the name of MGM Industries through written authorization of Veka Inc., to whom the original report was rendered. The original Veka Inc. report number is 68234.07-116-45.

The Condensation Resistance results obtained from this procedure are for controlled laboratory conditions and do not include the effects of air movement through the specimen, solar radiation, and the thermal bridging that may occur due to the specific design and construction of the fenestration system opening.

Ratings values included in this report are for submittals to an NFRC-licensed IA and are not meant to be used directly for labeling purposes. Only those values identified on a valid Certification Authorization Report (CAR) by an NFRC accredited Inspection Agency (IA) are to be used for labeling purposes. The ratings values were rounded in accordance to the NFRC unit conversion and rounding policy.

Architectural Testing is an NFRC accredited simulation laboratory and all simulations were conducted in full compliance with NFRC approved procedures and specifications. The NFRC procedure requires that the computational results be verified through actual test results.

Detailed drawings, simulation data files, a copy of this report, or other pertinent project documentation will be retained by Architectural Testing, Inc. for a period of four years from the original test date. At the end of this retention period, such materials shall be discarded without notice and the service life of this report will expire. Results obtained are simulated values and were secured by using the designated test methods. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. It is the exclusive property of the client so named herein and relates only to the product simulated. This report may not be reproduced, except in full, without the written approval of Architectural Testing, Inc.

For ARCHITECTURAL TESTING, INC.:

SIMULATED BY:

REVIEWED BY:

Polina A. Stauffer
Simulation Technician

Kristen L. Livelsberger
Senior Simulation Technician
Simulator-In-Responsible-Charge

PAS:PAS
68234.09-116-45

Attachments (pages): This report is complete only when all attachments listed are included.
Appendix A: Drawings and Bills of Material (2)

Revision Log

<u>Rev. #</u>	<u>Date</u>	<u>Page(s)</u>	<u>Revision(s)</u>
.01R0	10/10/2006	All	Original report issue
.04R0	6/13/2008	All	Added Equal Lite Configuration
.07R0	10/15/2008	All	Add Options #13-17
.09R0	3/19/2009	All	Reissued report in the name of MGM Industries



All drawings and Bills of Material used to simulate this product are enclosed in this Appendix

Appendix A

68234.09-116-45




ATI

Report # 68234-116-45

Date 06-10-2008

Simulator *Polina Sautter*

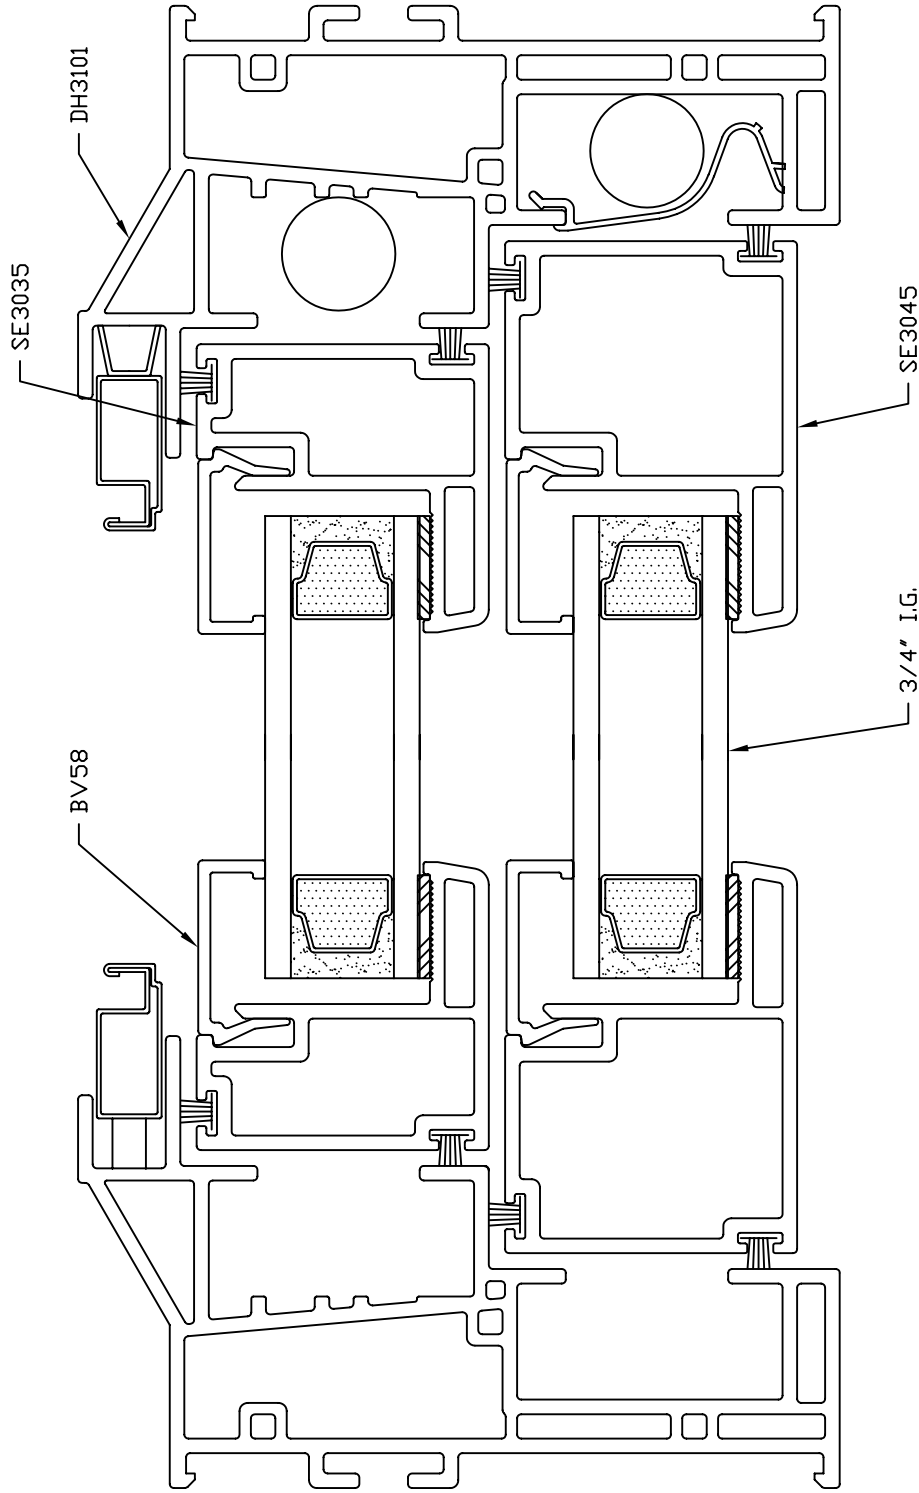


VEKA INC.
100 VEKA DRIVE
FOMBELL, PA 16123

DRAWN: JMN	DATE: 31 AUG 95	SCALE: FULL
CHK'D:	DATE:	APPV'D:
TITLE: DOUBLE HUNG DH31WV, DH31MW		
EQ. GLASS HORIZONTAL ASSEMBLY		
DWG. # DH31WWEH		

REVISIONS	DATE

NOTE:
FOR OTHER PROFILE, GLAZING BEAD,
& GLASS OPTIONS, PLEASE SEE THE
LINEAL PROFILE CHARTS FOR THIS
SYSTEM.

The information, design or data shown on this document or electronic media is the exclusive property of Veka Inc.. It is considered confidential and proprietary and is made available for limited use only. Its use or reproduction without the expressed written consent of Veka Inc. is prohibited.

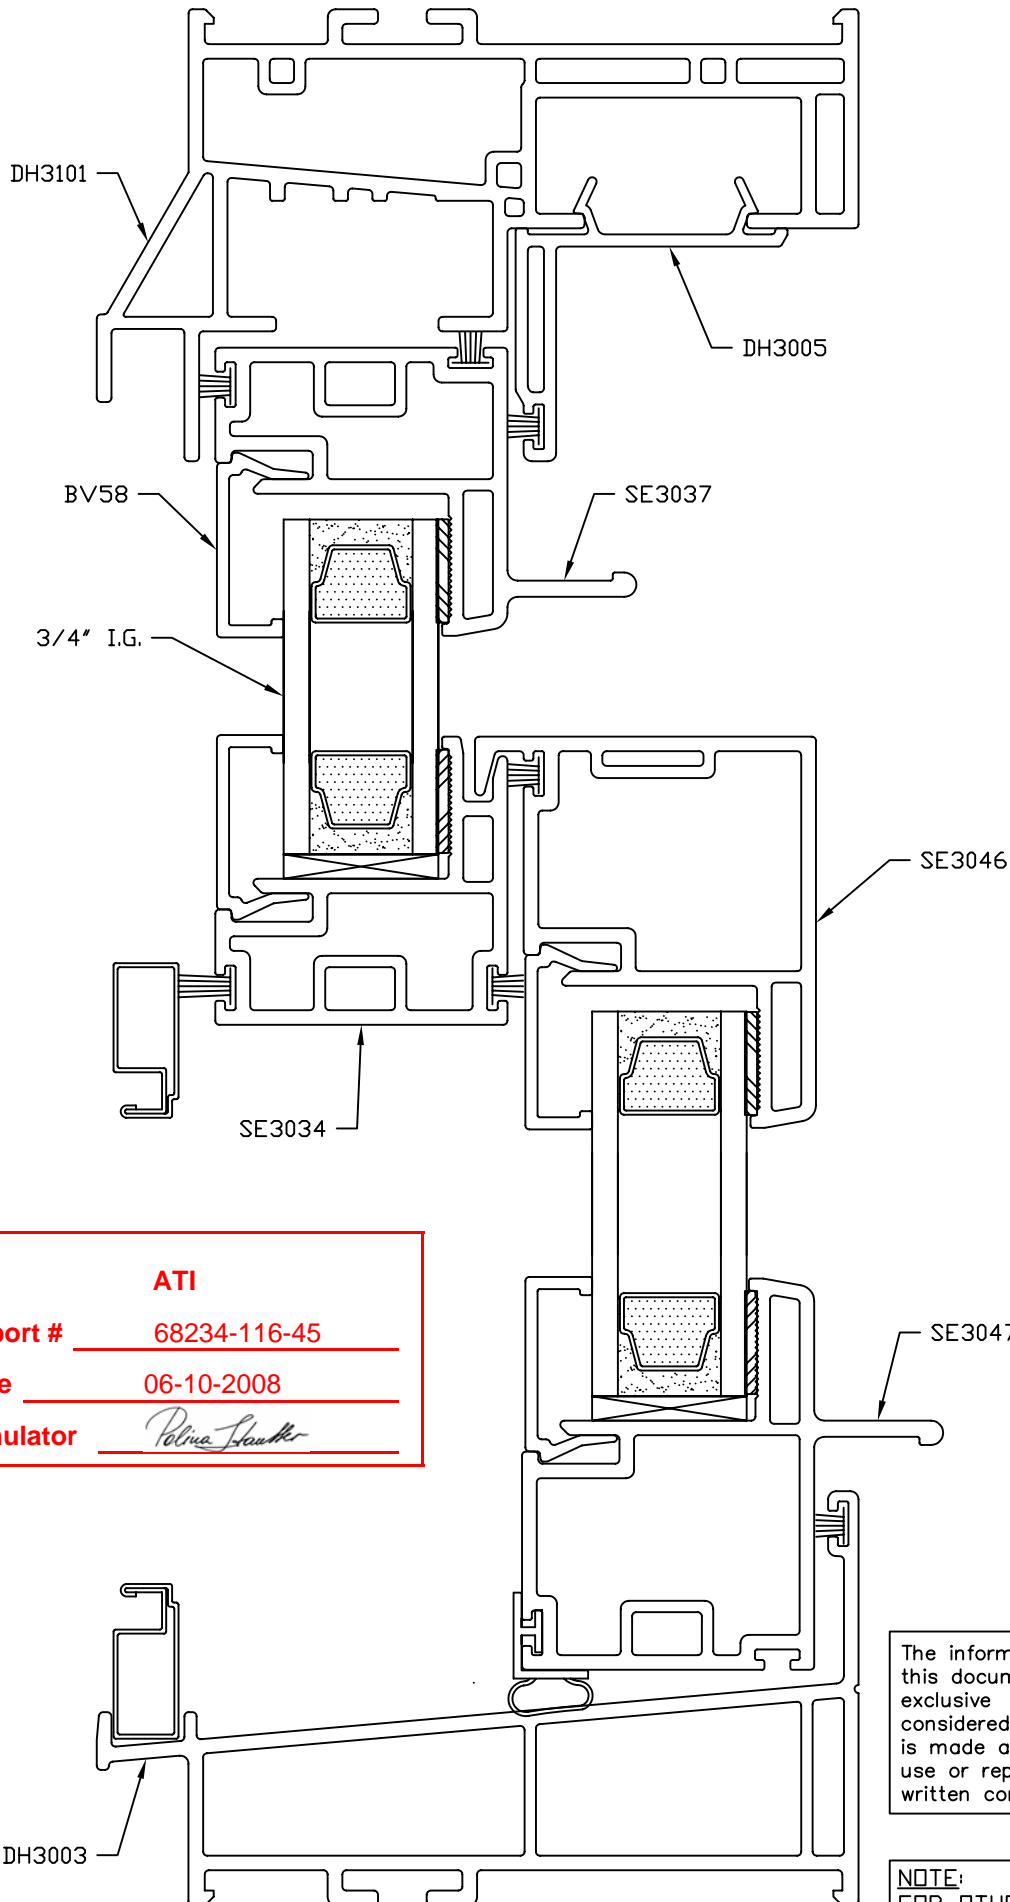

VEKA INC.
 100 VEKA DRIVE
 FOMBELL, PA 16123

DRAWN: JMN	DATE: 31 AUG 95	SCALE: FULL
CHK'D:	DATE:	APPV'D:
TITLE: DOUBLE HUNG DH31WW EQ. GLASS VERTICAL ASSEMBLY		
DWG. # DH31WWEV		

REVISIONS	DATE
1. REVISED DH3003	18 SEPT 03

ATI
Report # 68234-116-45
Date 06-10-2008
Simulator Polina Sautter

The information, design or data shown on this document or electronic media is the exclusive property of Veka Inc.. It is considered confidential and proprietary and is made available for limited use only. Its use or reproduction without the expressed written consent of Veka Inc. is prohibited.

NOTE:
 FOR OTHER PROFILE, GLAZING BEAD, & GLASS OPTIONS, PLEASE SEE THE LINEAL PROFILE CHARTS FOR THIS SYSTEM.

DH3003